


- LEGEND (FOR THIS DWG ONLY)**
- ⑤ CEILING MOUNTED AREA TYPE SMOKE DETECTOR
 - ⑥ DET MOUNTED SMOKE DETECTOR
 - ⑦ COMBINATION GONG & STROBE - HSD-24 OUTPUT MODULE (IN PANEL) AA-304
 - FIRE ALARM WIRING IN RIGID STEEL CONDUIT RUN IN CEILING AND/OR WALL
 - WIRE RUN TO EXISTING SMOKE DETECTION PANEL

- NOTES**
- 1- FOR SMOKE DETECTION SPECIFICATIONS SEE DRAWING 103R-E2.
 - 2- PROVIDE ADDITIONAL J-box MODULES, OUTPUT MODULES AND RELAY MODULES AS REQUIRED TO OBTAIN OPERATION AS SPECIFIED.

THESE AREAS ARE FULLY SERVED BY UNDERFLOOR & CEILING (AREA) SMOKE DETECTOR HEADS. ADD'L CEILING HEADS BEING INSTALLED TO CONFORM TO NEW ROOM LAYOUT AS NECESSARY.

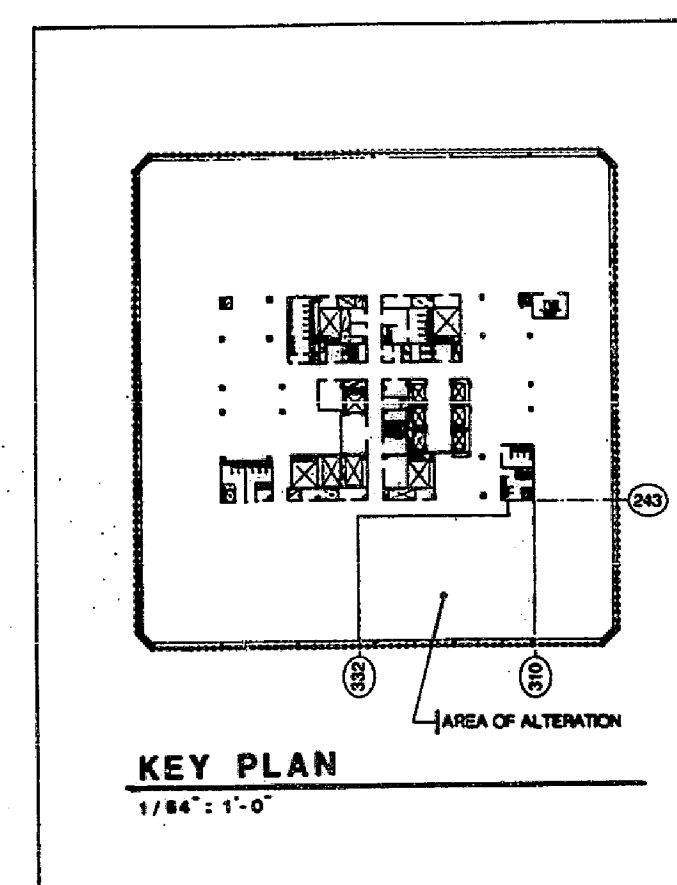

JOHN C. WESTRICK & ASSOCIATES
CONSULTING ENGINEERS
210 MAPLEAVE, SOUTH PLAINFIELD, N.J. 07080 908 561-4170

DATE	ISSUED TO	PR	TR
10/24/92	POST AUTHORITY FOR APPROVAL	12	-
1/22/93	C.F.E.C.	2	-
6-10-93	POST AUTHORITY FOR APPROVAL	12	-
8-25-93	POST AUTHORITY FOR APPROVAL	12	-

CANTOR, FITZGERALD SECURITIES CORP.
105th FLOOR
ONE WORLD TRADE CENTER, NEW YORK, N.Y.

PROPOSED ALTERATION TO G.S.B. TRADING ROOM SMOKE DETECTION PLAN

PROJECT NO. 92119

SCALE 1/8" = 1'-0"

DRAWN BY SLG

CHECKED BY JCW

DATE 4-27-92

T.A.A. NO.

105 R-E-7